



# ENERG


енергия · ενεργεια




100777HSV12141

alpha innotec

LWAV 122R3-HSV 12.1M3

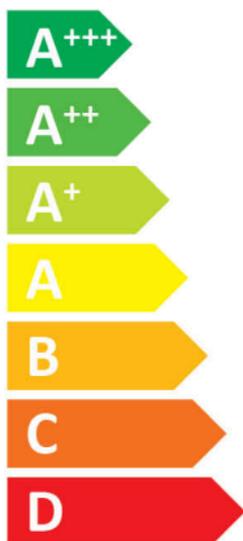

A++

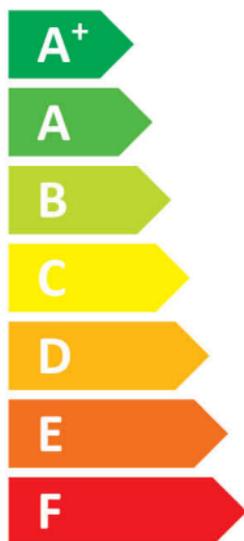

A

Two icons showing sound power levels. The top icon shows a speaker inside a house with the text "44 dB". The bottom icon shows a speaker outside a house with the text "58 dB".



Legend for power consumption in kW:

- Dark blue square: 7 kW
- Medium blue square: 9 kW
- Light blue square: 7 kW

Icon representing energy saving, showing a clock face and a stack of coins with an arrow pointing down.



# ENERGY


100777HSV12141

alpha innotec

LWAV 122R3-HSV 12.1M3



A++

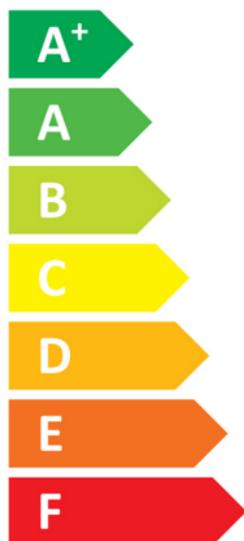

A



44 dB



58 dB



7 kW

9 kW

7 kW





# ENERG

енергия · ενεργεια

Y

IJA

IE

IA

100777HSV12141

alpha innotec

LWAV 122R3-HSV 12.1M3 + Luxtronik 2.1

A++

A

XL

A+++

A++

A+

A

B

C

D

E

F

G

A++

- +
- +
- +
- +

XL

A+++

A++

A+

A

B

C

D

E

F

G

A

**package (heat pumps and combination heater with heat pump) LWAV 122R3-HSV 12.1M3 + Luxtronik 2.1**

Seasonal space heating energy efficiency of heat pump ( $\eta_s$ ) ① 132 %

**Rated heat output of the heat pump ( $P_{rated}$  kW)** 9

Temperature control Class VII (Table 1) + ② 3,5 %

Supplementary boiler

package with hot water storage tank

no  $P_{sup}$  kW (rated heat output of supplementary heater)

$\eta_s$  % ( $\sigma_{\pi}$ )

$(\eta_s \% (sup) - ①) \times (\alpha_{WP}) = -$  ③

( $\alpha_{WE}$ : see Table 3)

( $\alpha_{WE}$ )

solar contribution


$(A_{Koll} \text{ m}^2)$   $(\eta_{Koll} \%)$   
 $(V_{Sp} \text{ m}^3)$  **(standstill heat loss of the hot water storage tank in W)**  
 $(\eta_{Sp}: \text{Table 2})$

$((294/P_{rated} \times 11) \times (A_{Koll} \text{ m}^2) + (115/P_{rated} \times 11) \times (V_{Sp} \text{ m}^3)) \times 0,45 \times ((\eta_{Koll} \%) / 100) \times (\eta_{Sp}) = +$  ④

Seasonal space heating energy efficiency of package ⑤ 135 %

*rounded to the nearest integer*

Seasonal space heating energy efficiency class of package

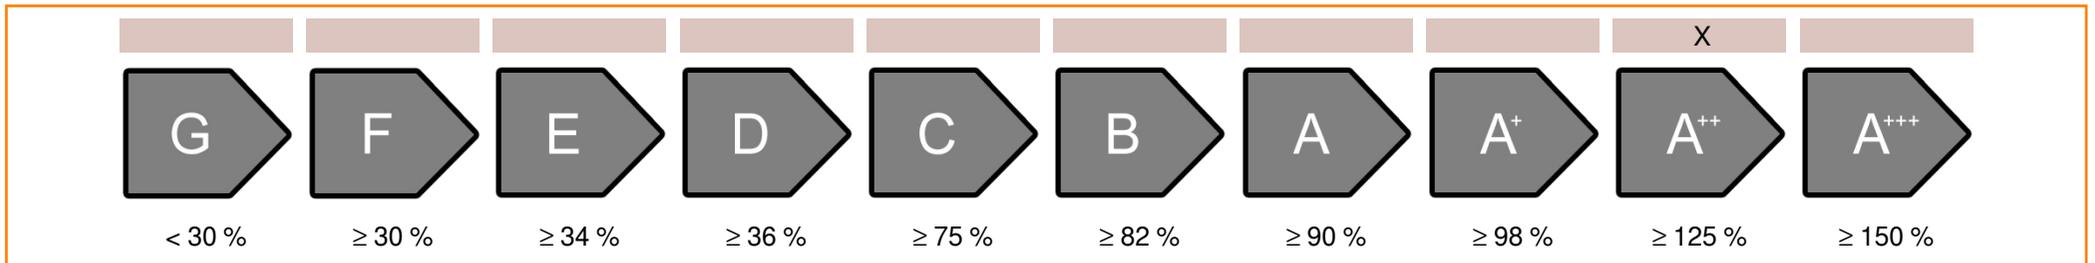

Seasonal space heating energy efficiency under colder or warmer climate conditions

**Seasonal space heating energy efficiency of the heat pump ( $\eta_s$ ) under colder climate conditions** 112 %

**Seasonal space heating energy efficiency of the heat pump ( $\eta_s$ ) under warmer climate conditions** 150 %

colder ⑤ 135 -V 19 = 116 warmer ⑤ 135 +VI 18 = 153

<b>heatpump datasheet:</b>			
<b>manufacturer:</b>	alpha innotec		
<b>model:</b>	LWAV 122R3-HSV 12.1M3		
<b>Information concerning energy efficiency class and rated heat output:</b>			
load profile water heating	XL		-
	average / low	average / medium	
energy efficiency class space heater:	A++	A++	-
energy efficiency class waterheating	A		-
rated heat output:	10	9	kW
annual final energy consumption space heater	4681	5398	kWh
annual electricity consumption waterheating	1767		kWh
energy efficiency space heater:	174	132	%
energy efficiency waterheating	95		%
sound power level indoors	44		dB
<b>special precautions concerning assembly, installation or maintenance</b>			
All instructional work in this manual may only be carried out by qualified specialist personnel in compliance with local regulations.			
<b>additional information</b>	low	medium	
rated heat output colder climate	9	7	kW
rated heat output warmer climate	7	7	kW
annual energy consumption space heater colder climate	6290	5984	kWh
annual energy consumption space heater warmer climate	1887	2268	kWh
ann. Electricity consumption waterheating colder climate	1940		kWh
ann. Electricity consumption waterheating warmer climate	1525		kWh
energy efficiency space heater colder climate	132	112	%
energy efficiency space heater warmer climate	181	150	%
energy efficiency waterheating colder climate	86		%
energy efficiency DHWarmer climate	110		%
sound power level outdoors	58		dB

<b>technical data of the temperature controller</b>		
<b>manufacturer:</b>	<b>alpha innotec</b>	
<b>model:</b>	<b>Luxtronik 2.1</b>	
controller class	VII	-
contribution of the controller to the energy efficiency space heater	3,5	%

<b>Model</b>				<b>LWAV 122R3-HSV 12.1M3</b>			
Air-to-water heat pump: (yes/no)				yes			
Brine-to-water heat pump: (yes/no)				no			
Water-to-water heat pump: (yes/no)				no			
Low-temperature heat pump: (yes/no)				no			
Equipped with supplementary heater: (yes/no)				yes			
combination heater with: (yes/no)				yes			
application: (low/medium)				medium			
climate: (colder/average/warmer)				average			
<b>Item</b>	<b>Symbol</b>	<b>Value</b>	<b>Unit</b>	<b>Item</b>	<b>Symbol</b>	<b>Value</b>	<b>Unit</b>
<b>Rated heat output</b>	Prated	9	kW	<b>Seasonal space heating energy efficiency</b>	$\eta_S$	131,7	%
<b>Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature Tj</b>				<b>Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature Tj</b>			
Tj = -7°C	Pdh	8,3	kW	Tj = -7°C	COPd	2,18	-
Tj = +2°C	Pdh	4,8	kW	Tj = +2°C	COPd	3,28	-
Tj = +7°C	Pdh	5,2	kW	Tj = +7°C	COPd	4,54	-
Tj = +12°C	Pdh	6,0	kW	Tj = +12°C	COPd	6,15	-
Tj = bivalent temperature	Pdh	8,3	kW	Tj = bivalent temperature	COPd	2,18	-
Tj = operation limit temperature	Pdh	6,7	kW	Tj = operation limit temperature	COPd	1,94	-
For air-to-water heat pumps: Tj = -15°C (if TOL < -20°C)	Pdh	-	kW	For air-to-water heat pumps: Tj = -15°C (if TOL < -20°C)	COPd	-	-
Bivalent temperature	T <sub>biv</sub>	-7	°C	For air-to-water heat pumps: Operation limit temperature	TOL	-10	°C
Cycling interval capacity for heating	Pcyc	-	kW	Cycling interval efficiency	COPcyc	-	-
Degradation co-efficient (**)	Cdh	1,0	-	Heating water operating limit temperature	WTOL	60	°C
<b>Power consumption in modes other than active mode</b>				<b>Supplementary heater</b>			
Off mode	P <sub>OFF</sub>	0,020	kW	Rated heat output	P <sub>sup</sub>	2,1	kW
Thermostat-off mode	P <sub>TO</sub>	0,020	kW	Type of energy input	electrical		
Standby mode	P <sub>SB</sub>	0,020	kW				
Crankcase heater mode	P <sub>CK</sub>	-	kW				
<b>Other items</b>							
Capacity control	variable			For air-to-water heat pumps: Rated air flow rate, outdoors	-	2.900	m <sup>3</sup> /h
sound power level, indoors/outdoors	L <sub>WA</sub>	44 / 58	dB	For water-/brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger	-	-	m <sup>3</sup> /h
Emissions of nitrogen oxides	NO <sub>x</sub>	-	mg/kWh				
<b>For heat pump combination heater:</b>							
Declared load profile	XL			Water heating energy efficiency	$\eta_{wh}$	95	%
Daily electricity consumption	Q <sub>elec</sub>	8,341	kWh	Daily fuel consumption	Q <sub>fuel</sub>	-	kWh
<b>Contact details</b>	ait deutschland GmbH Industriestr. 3 95359 Kasendorf Germany						
(*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).							
(**) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.							

<b>Model</b>				<b>LWAV 122R3-HSV 12.1M3</b>			
Air-to-water heat pump: (yes/no)				yes			
Brine-to-water heat pump: (yes/no)				no			
Water-to-water heat pump: (yes/no)				no			
Low-temperature heat pump: (yes/no)				no			
Equipped with supplementary heater: (yes/no)				yes			
combination heater with: (yes/no)				yes			
application: (low/medium)				low			
climate: (colder/average/warmer)				average			
<b>Item</b>	<b>Symbol</b>	<b>Value</b>	<b>Unit</b>	<b>Item</b>	<b>Symbol</b>	<b>Value</b>	<b>Unit</b>
<b>Rated heat output</b>	Prated	10	kW	<b>Seasonal space heating energy efficiency</b>	$\eta_S$	173,5	%
<b>Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature Tj</b>				<b>Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature Tj</b>			
Tj = -7°C	Pdh	8,5	kW	Tj = -7°C	COPd	2,60	-
Tj = +2°C	Pdh	5,3	kW	Tj = +2°C	COPd	4,52	-
Tj = +7°C	Pdh	6,3	kW	Tj = +7°C	COPd	6,04	-
Tj = +12°C	Pdh	6,7	kW	Tj = +12°C	COPd	7,34	-
Tj = bivalent temperature	Pdh	8,5	kW	Tj = bivalent temperature	COPd	2,60	-
Tj = operation limit temperature	Pdh	7,5	kW	Tj = operation limit temperature	COPd	2,58	-
For air-to-water heat pumps: Tj = -15°C (if TOL < -20°C)	Pdh	-	kW	For air-to-water heat pumps: Tj = -15°C (if TOL < -20°C)	COPd	-	-
Bivalent temperature	T <sub>biv</sub>	-7	°C	For air-to-water heat pumps: Operation limit temperature	TOL	-10	°C
Cycling interval capacity for heating	Pcych	-	kW	Cycling interval efficiency	COPcyc	-	-
Degradation co-efficient (**)	Cdh	1,0	-	Heating water operating limit temperature	WTOL	60	°C
<b>Power consumption in modes other than active mode</b>				<b>Supplementary heater</b>			
Off mode	P <sub>OFF</sub>	0,020	kW	Rated heat output	P <sub>sup</sub>	2,5	kW
Thermostat-off mode	P <sub>TO</sub>	0,020	kW	Type of energy input	electrical		
Standby mode	P <sub>SB</sub>	0,020	kW				
Crankcase heater mode	P <sub>CK</sub>	-	kW				
<b>Other items</b>							
Capacity control	variable			For air-to-water heat pumps: Rated air flow rate, outdoors	-	2.900	m <sup>3</sup> /h
sound power level, indoors/outdoors	L <sub>WA</sub>	44 / 58	dB	For water-/brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger	-	-	m <sup>3</sup> /h
Emissions of nitrogen oxides	NO <sub>x</sub>	-	mg/kWh				
<b>For heat pump combination heater:</b>							
Declared load profile	-			Water heating energy efficiency	$\eta_{wh}$	-	%
Daily electricity consumption	Q <sub>elec</sub>	-	kWh	Daily fuel consumption	Q <sub>fuel</sub>	-	kWh
<b>Contact details</b>	ait deutschland GmbH Industriestr. 3 95359 Kasendorf Germany						
(*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).							
(**) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.							